
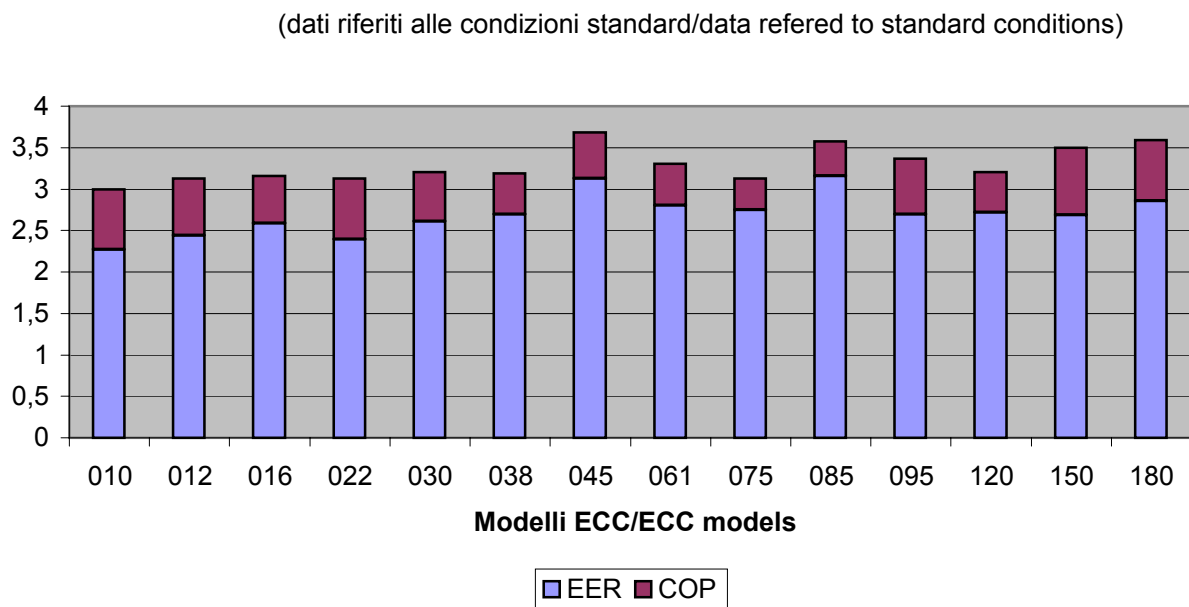


# Indici EER e COP/EER and COP index

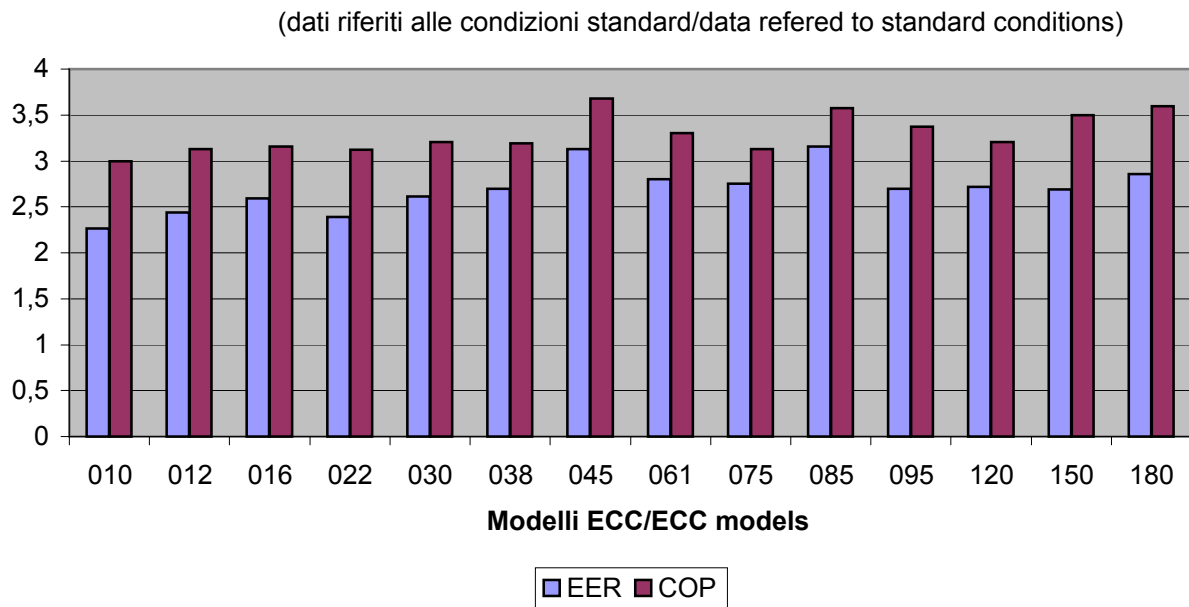

Dati riferiti a/Data referred to :

Temperatura ingresso/uscita fluido Inlet/Outlet water temperature = +12/+7 °C

Temperatura ambiente / Ambient temperature = +35°C